Haier SERVICE MANUAL

Model 1U25S2SM1FA-2



WARNING

This service information is designed for experienced repair technicians only and is not designed for use by the general public. It does not contain warnings or cautions to advise non-technical individuals of potential dangers in attempting to service a product. Products powered by electricity should be serviced or repaired only by experienced professional technicians. Any attempt to service or Repair the product or products dealt with in this service information by anyone else could result in serious injury or death

> 2018 (Qingdao Haier Air Conditioner General corp. , Ltd) All rights reserved. Unauthorized copying and distribution is a violation of law

Haier Group

Version: V1 Date: 2021-04-23




Domestic air conditioner

Contents

1. Introduction	.1
2. Specifications	.7
3. Sensors list	.8
4. Piping diagrams	.9
5. Operation range	10
6. Printed circuit board connector wiring diagram	11
7. Functions and control	.15
8. Dimensional drawings	29
9. Center of gravity	29
10. Service diagnosis	30
11. Performance and curves diagrams	48
12. Circuit diagrams	56

1. Introduction

1.1 Model name explanation

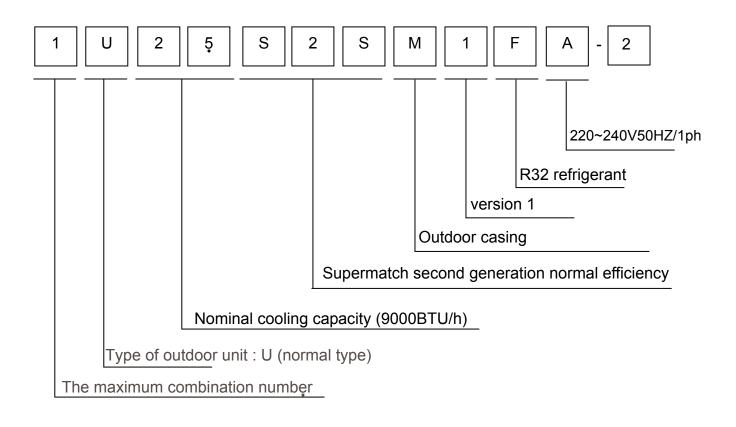

1.2 Safety Cautions

Be sure to read the following safety cautions before conducting repair work.

The caution items are classified into "Warning" and "Caution". The "Warning" items are especially important since they can lead to death or serious injury if they are not followed closely. The "Caution" items can also lead to serious accidents under some conditions if they are not followed. Therefore, be sure to observe all the safety caution items described below.

About the pictograms

 \bigtriangleup This symbol indicates an item for which caution must be exercised.

The pictogram shows the item to which attention must be paid.

 \circ This symbol indicates a prohibited action.

The prohibited item or action is shown inside or near the symbol.

• This symbol indicates an action that must be taken, or an instruction.

The instruction is shown inside or near the symbol.

After the repair work is complete, be sure to conduct a test operation to ensure that the equipment operates Normally, and explain the cautions for operating the product to the customer.

1.2.1 Embedded wire checking before installation

Check the embedded wire diameter suitable to request:

(Power supply from indoor: $2.5kw \ge 1.0mm^2 3.5kw, 5kw \ge 1.5mm^2 7kw \ge 2.5mm^2$; Power supply from outdoor $\ge 1.0mm^2$)

Check the embedded wire are four roots, L/N/COM/GND; GND is needed, if not, thunder or high voltage wave from power grid will impact to the performance

Using a multi-meter to test short circuit of the four roots wires, make sure no short circuit happen.





1.2.2 Caution in Repair

Warning

Be sure to disconnect the power cable plug from the plug socket before disassembling the equipment for a repair.

Working on the equipment that is connected to a power supply can cause an electrical shook.

If it is necessary to supply power to the equipment to conduct the repair or inspecting the circuits, do not touch any electrically charged sections of the equipment.

If the refrigerant gas discharges during the repair work, do not touch the discharging refrigerant gas .The refrigerant gas can cause frostbite.



Intuoduction

When disconnecting the suction or discharge pipe of the compressor at the welded section, release the	
refrigerant gas completely at a well-ventilated place first.	
If there is a gas remaining inside the compressor, the refrigerant gas or refrigerating machine oil	
discharges when the pipe is disconnected, and it can cause injury.	
If the refrigerant gas leaks during the repair work, ventilate the area. The refrigerant gas can generate toxic gases when it contacts flames.	0
The step-up capacitor supplies high-voltage electricity to the electrical components of the outdoor unit.	
Be sure to discharge the capacitor completely before conducting repair work . A charged capacitor can	
cause an electrical shock.	
Do not start or stop the air conditioner operation by plugging or unplugging the power cable plug.	
Plugging or unplugging the power cable plug to operate the equipment can cause an electrical shock or	(\mathbf{N})
fire.	

Warning	
Do not repair the electrical components with wet hands . Working on the equipment with wet hands can cause an electrical shock	\bigcirc
Do not clean the air conditioner by splashing water. Washing the unit with water can cause an electrical shock.	\bigcirc
Be sure to provide the grounding when repairing the equipment in a humid or wet place, to avoid electrical shock.	
Be sure to turn off the power switch and unplug the power cable when cleaning the equipment. The internal fan rotates at a high speed, and cause injury.	
Do not tilt the unit when removing it. The water inside the unit can spill and wet the furniture and floor.	\bigcirc
Be sure to check that the refrigerating cycle section has cooled down sufficiently before conducting repair work. Working on the unit when the refrigerating cycle section is hot can cause burns.	
Use the welder in a well-ventilated place. Using the welder in an enclosed room can cause oxygen deficiency.	0

1.2.3 Cautions Regarding Products after Repair

Warning

Be sure to use parts listed in the service parts list of the applicable model and appropriate tools to

Intuoduction

conduct repair work. Never attempt to modify the equipment. The use of inappropriate parts or tools can	
cause an electrical shock, excessive heat generation or fire.	
When relocating the equipment, make sure that the new installation site has sufficient strength to	
withstand the weight of the equipment.	
If the installation site does not have sufficient strength and if the installation work is not conducted	
securely, the equipment can fall and cause injury.	
Be sure to install the product correctly by using the provided standard installation frame.	For
Incorrect use of the installation frame and improper installation can cause the equipment to fall, resulting	integral
in injury.	units only
Po sure to install the product accurate in the installation frame mounted on a window frame	For
Be sure to install the product securely in the installation frame mounted on a window frame.	
If the unit is not securely mounted, it can fall and cause injury.	units only

Warning	
Be sure to use an exclusive power circuit for the equipment, and follow the technical standards related to the electrical equipment, the internal wiring regulations and the instruction manual for installation when conducting electrical work. Insufficient power circuit capacity and improper electrical work can cause an electrical shock or fire.	
Be sure to use the specified cable to connect between the indoor and outdoor units. Make the connections securely and route the cable properly so that there is no force pulling the cable at the connection terminals. Improper connections can cause excessive heat generation or fire.	
When connecting the cable between the indoor and outdoor units, make sure that the terminal cover does not lift off or dismount because of the cablę. If the cover is not mounted properly, the terminal connection section can cause an electrical shock, excessive heat generation or fire.	
Do not damage or modify the power cable. Damaged or modified power cable can cause an electrical shock or fire. Placing heavy items on the power cable, and heating or pulling the power cable can damage the cable.	\bigcirc
Do not mix air or gas other than the specified refrigerant (R32) in the refrigerant system. If air enters the refrigerating system, an excessively high pressure results, causing equipment damage and injury.	
If the refrigerant gas leaks, be sure to locate the leak and repair it before charging the refrigerant. After charging refrigerant, make sure that there is no refrigerant leak. If the leak cannot be located and the repair work must be stopped, be sure to perform pump-down and close the service valve, to prevent the refrigerant gas from leaking into the room. The refrigerant gas	

itself	
is harmless, but it can generate toxic gases when it contacts flames, such as fan and other heaters,	
stoves and ranges.	
When replacing the coin battery in the remote controller, be sure to disposed of the old battery to prevent children from swallowing it. If a child swallows the coin battery, see a doctor immediately.	

Caution	
Installation of a leakage breaker is necessary in some cases depending on the conditions of the installation site, to prevent electrical shocks.	
Do not install the equipment in a place where there is a possibility of combustible gas leaks. If a combustible gas leaks and remains around the unit, it can cause a fire.	\bigcirc
Be sure to install the packing and seal on the installation frame properly. If the packing and seal are not installed properly, water can enter the room and wet the furniture and floor.	

1.2.4 Inspection after Repair

Warning	
Check to make sure that the power cable plug is not dirty or loose, then insert the plug into a power outlet all the way. If the plug has dust or loose connection, it can cause an electrical shock or fire.	0
If the power cable and lead wires have scratches or deteriorated, be sure to replace them. Damaged cable and wires can cause an electrical shock, excessive heat generation or fire.	9

Warning

Do not use a joined power cable or extension cable, or share the same power outlet with other electrical appliances since it can cause an electrical shock, excessive heat generation or fire.

Caution	
Check to see if the parts and wires are mounted and connected properly, and if the connections at the	
soldered or crimped terminals are secure. Improper installation and connections can cause excessive	
heat generation, fire or an electrical shock.	
If the installation platform or frame has corroded, replace it. Corroded installation platform or frame can	
cause the unit to fall, resulting in injury.	
Check the grounding, and repair it if the equipment is not properly grounded. Improper grounding can cause an electrical shock.	9
Be sure to measure the insulation resistance after the repair, and make sure that the resistance is 1 M	
ohm or higher.	
Faulty insulation can cause an electrical shock.	
Be sure to check the drainage of the indoor unit after the repair.	
Faulty drainage can cause the water to enter the room and wet the furniture and floor.	

1.2.4 Using Icons

Icons are used to attract the attention of the reader to specific information. The meaning of each icon is described in the table below:

1.2.5 Using Icons List

Icon	Type of Information	Description
i _{Note}	Note	A "note" provides information that is not indispensable, but may nevertheless be valuable to the reader, such as tips and tricks.
A Çaution	Caution	A "caution" is used when there is danger that the reader, through incorrect manipulation, may damage equipment, loose data, get an unexpected result or has to restart (part of) a procedure.
	Warning	A "warning" is used when there is danger of personal injury.
L	Reference	A "reference" guides the reader to other places in this binder or in this manual, where he/she will find additional information on a specific topic.

2.Specifications

NOMINAL DISTRIBUTION SYSTEM VOLTAGE			
Phase	/ .	1	
Frequency	Hz	50	
Voltage	V	220-240	

NOMINAL CAPACITY and NOMINAL INPUT				
	Cooling	heating		
Capacity rated	kW	2.60	3.20	
	Btu/h	8870	10920	
Power Consumption(Rated)	kW	0.65	0.8	
SEER/SCOP	Ŵ/W	8.5	4.6	
Annual energy consumption	kWh	107	731	
Moisture Removal	m³/h	1.2*10 - ³		

TECHNICAL SPECIFICATIONS-UNIT			
Dimensions	H*W*D	mm	800×553×275
Packaged	H*W*D		902×607×375
Dimensions		mm	902×007×375
Weight	1	KG	27.6
Gross weight	1	KG	30.4
Cound loval	Sound pressure	dB	47
Sound level	Sound power	dB	59

ELECTRICAL SPECIFICATIONS				
		Cooling	heating	
Nominal running current	А	2.9	3.6	
Maximum running current	А	5.5	7.2	
Starting current	А	1	1	

TECHNICAL SPECIFICATIONS-PARTS				
			cooling	heating
	Туре		Rotary Compressor	
	Model		GSD098RKTF6JV6	В
Compressor	Motor output	W	767	
	Oil type		ASC-68R or equivalent	
	Oil charge volume	L	0.280±0.02	
	Туре		Axial fan	
Fan	Motor output	W	50	
Fall	Air flow rate(high)	m³/h	1900	
	Speed(high/low)	rpm	800/300	
Heat	Туре		ML fin-φ7HI-HX tube	9

-				Op
exchanger	Row*stage*fitch		1*12*1.4	
TECHNICAL SP	ECIFICATIONS-OTHERS			
	Refrigerant type	Refrigerant type		R32
	Refrigerant charge		KG	0.63
Refrigerant	Maximum allowable dista	ance	М	20
circuit	between indoor an outdo	or	IVI	20
	Maximum allowable level difference		m	10
	Refrigerant control		EEV	
	liquid		mm	Ф6.35
Piping connections		as	mm	Ф9.52
(external diame	eter) drain		mm	Ф16
Heat insulation type			Both liquid and Gas pipes	
Max. piping Length			m	20
Max. Level Difference			m	10
Chargeless			m	7
Amount of Additional Charge of Refrigerant			g/m	20

Note: the data are based on the conditions shown in the table below

cooling	heating	Piping length
Indoor: 27°CDB/19°CWB	Indoor:20°CDB	5m
Outdoor: 35°CDB/24°CWB	Outdoor: 7℃DB/6℃WB	511


Conversation formulae
Kcal/h= kW×860
Btu/h= kW×3414
cfm=m³/min×35.3

3.Sensors list


type	Description	Qty
Ambient sensor	Its used for detecting temperature of outdoor side	
Defrosting sensor	Its used for controlling outdoor defrosting at heating mode	1
Descharging sensor	Its used for compressor in case of over-heat	

4. Piping diagrams

Cooling mode

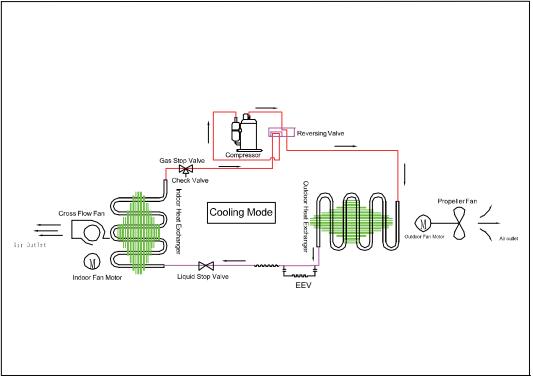


Heating mode

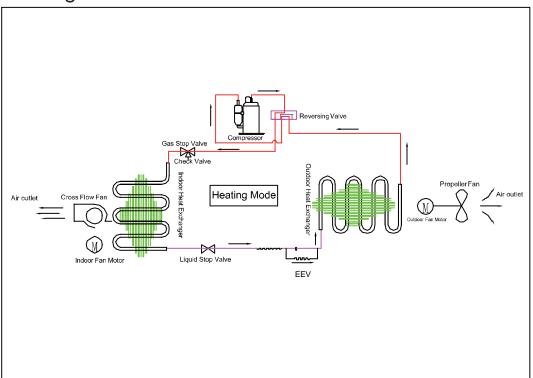

Haier


5. Operation range

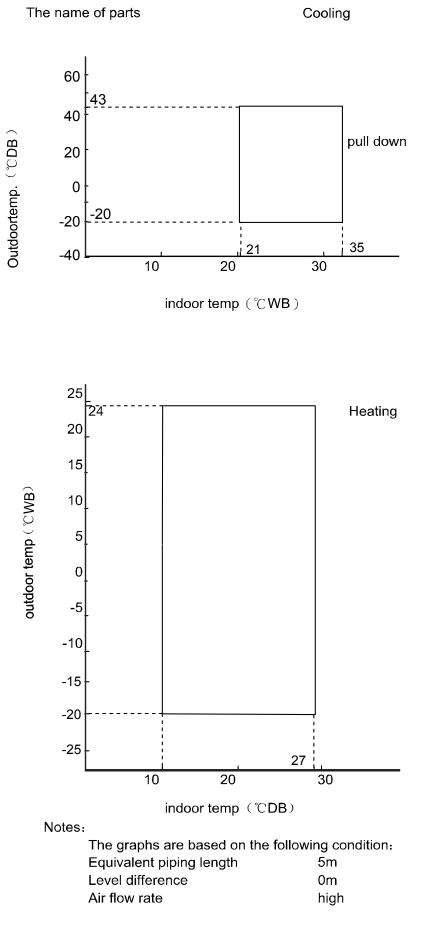

6. Printed circuit board connector wiring diagram


PCB (Control PCB)

1	CN1	Connector for power N and L
2	CN2	
3	CN3	Connector for ground
4	CN7	Connector for the U, V, W wire of the compressor
5	CN8	
6	CN9	
7	L-IN (CN5)	Connector for reactor
8	L-OUT (CN6)	
9	CN10	Connector for fan motor
10	CN11	Connector for four way valve coil
11	CN15	Connector for Temperature sensor
12	CN12	Connector for HEATER
13	CN4	Connector for communicate between indoor and outdoor unit
14	CN16	Connector for electric expansion valves

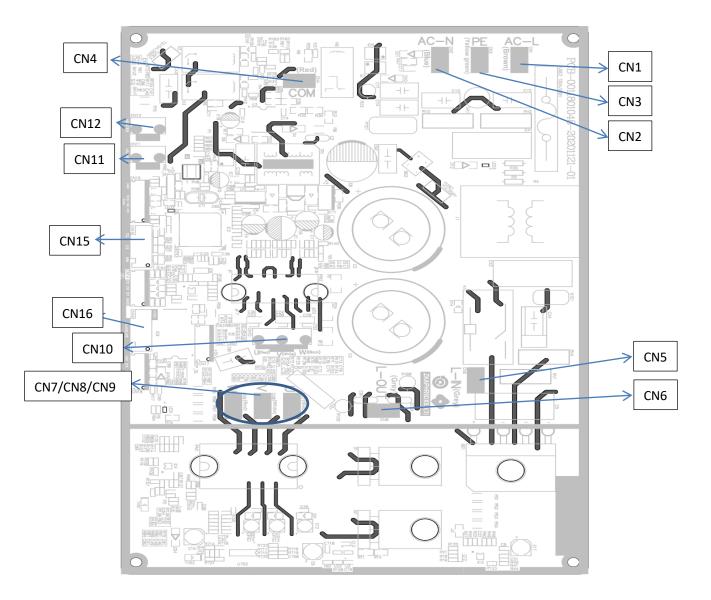

Wiring diagrams

OUTDOOR UNIT

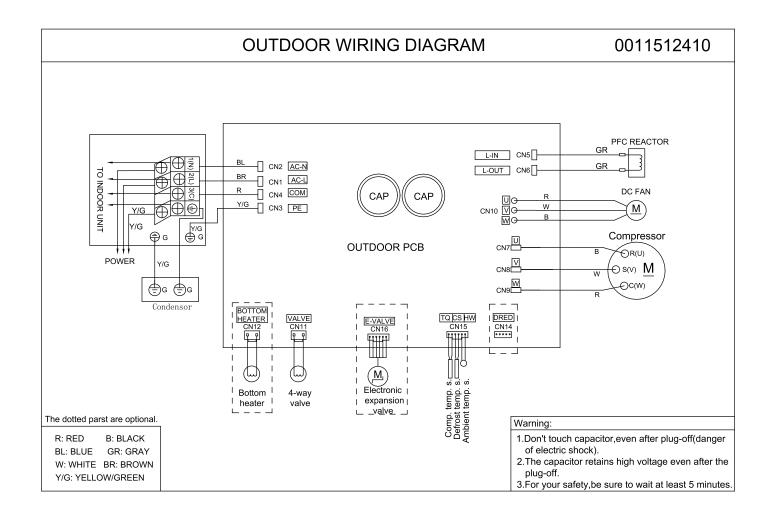

7.1 Main functions and control specification

7.1.1 The operation frequency of outdoor unit and its control

7.1.1.1 The operation frequency control of compressor

The operation frequency scope of compressor:

Mode	Minimum operation frequency	Maximum operation frequency
Heating (09K)	30Hz	75Hz
Refrigeration (09K)	30Hz	99 Hz

7.1.1.2 The starting of compressor

When the compressor is started for the first time, it must be kept under the conditions of 38Hz,58Hz,88Hz for 30second,one minute, one minute (the overheating protection of the outdoor unit air-blowing temperature, immediately decrease the frequency when the compressor is overflowing and releasing the pressure), then it can be operated towards the target frequency. When the machine runs normally, there's no such process. After starting the compressor for operation, the compressor should run according to the calculated frequency, and every determined frequency for protection should be prior to the calculated frequency.

7.1.1.3 The speeds of increasing or decreasing the frequency of the compressor The speed of increasing or decreasing the frequency rapidly 1 ------1HZ/second The speed of increasing or decreasing the frequency slowly 2 ------1HZ/10seconds

7.1.1.4 The calculation of the compressor's frequency

Refrigeration/dehumidification mode:

Pn=(Nh_c- S_c)*10≥50	outdoor environment control
Pn=(Nh_c- S_c) *10<50	PID control

Heating mode:

Pn=(S_c -Nh_c) *10≥60	outdoor environment control
Pn=(S_c -Nh_c) *10<60	PID control

(Nh_c=indoor environment temperature S_c=setting temperature)

1) The minimum/maximum frequency limitation

A. While refrigerating: F-MAX-r is the maximum operation frequency of the compressor; F-MIN-r is the minimum operation frequency of the compressor.

B. While heating: F-MAX-d is the maximum operation frequency of the compressor; F-MIN-d is the minimum operation frequency of the compressor.

2) The frequency limitation which is affected by the environment temperature.

(Wh_c= environment temperature)

Heating mode:

Serial No.	Temperature scope	Frequency limitation (09K)
1	Wh_c<-12	Max_hz1 99HZ
2	Wh_c<-8	Max_hz2 99HZ

3	Wh_c<-2	Max_hz3	99HZ
4	Wh_c<5	Max_hz4	93HZ
5	Wh_c<10	Max_hz5	92HZ
6	Wh_c<17	Max_hz6	80HZ
7	Wh_c<20	Max_hz7	61HZ
8	Wh_c>=20	Max_hz8	55HZ

Remarks: The above are the maximum frequency limitations of the complete appliance which are affected by the environment, and they have nothing to do with the ability of the indoor unit.

Refrigeration/dehumidification mode:

Serial No.	Temperature scope	Frequency limitation (09K)	
1	Wh_c<16	Max_hz1 38HZ	
2	Wh_c<22	Max_hz2 41HZ	
3	Wh_c<29	Max_hz3 44HZ	
4	Wh_c<32	Max_hz4 49HZ	
5	Wh_c<40	Max_hz5 62HZ	
6	Wh_c<48	Max_hz6 56HZ	
7	Wh_c>=48	Max_hz7 41HZ	

Remarks: the above are not only the maximum frequency limitations of the complete appliance which are affected by the environment, but also the maximum ability limitation of the system. When the starting ability is not the maximum, its maximum frequency limitation is calculated by the following equations:

The frequency limitation which is affected by the temperature and under the condition of actual ability=the actual running system ability*the maximum frequency which is limited by the temperature and under the condition of maximum ability/the maximum designing ability of the system

Refrigeration/dehumidification mode:

The indoor setting airflow speed	Low	Medium	Quiet
The percentage of the			
rated frequency K	70%	85%	50%
(09K)			

Heating mode:

The indoor setting airflow speed	Low	Medium	Quiet
The percentage of the			
rated frequency K	80%	90%	51%
(09K)			

The calculation of the actual output frequency:

F= F-ED-*(rated frequency) × K

F-ED-*(rated frequency)= The frequency which is limited by the outdoor environment temperature Notes:

When refrigerating, it is needed to satisfy

F-MIN-d(compressor's Min_hz)< F<F-MAX-d(compressor's Max_hz)

When heating, it is needed to satisfy

F-MIN-r (compressor's Min_hz)< F<F-MAX-r (compressor's Max_hz)

PID control :

The innital frequency Sn is determined by Pn . We can calculate Hzoutf according to the value of Kp ,Ki ,Kd, Out_gain,Pn.Then , Fn = Sn + Hzoutf. The value of Fn is calculated in each sample time (60 seconds),and Fn is adujusted according to previous frequency of Sn and filtered output of Hzoutf.

7.1.2 The outdoor fan control (Exchange fan)

When the fan is changed among every airflow speed (including stop blowing), in order to avoid the airflow speed from skipping frequently, it must be kept under each mode for over 30 seconds, and then it can be changed to another mode (when refrigerating, the time is changed to 15 seconds).

7.1.2.1 The outdoor fan control

Within three minutes of compressor starting, the compressor is controled according to the ambient temperature.

Tao (°C)	Tao <22 ℃	22℃< Tao <28 ℃	Tao≥28 ℃
Refrigeration/dehumidification	610rpm	610rpm	610rpm
Tao (°C)	Tao <<10 ℃	10℃< Tao <17℃	Tao≥17 ℃
Heating	760rpm	520rpm	400rpm
			1-

After 3 minutes, the compressor is controled according to the ambient temperature and the frequency of the compressor.

Refrigeration/dehumidification frequency(Hz)09K		<32 Hz	32 Hz -43 Hz	≥43 Hz		
	≤22	610rpm	610rpm	610rpm		
	22-29	610rpm	710rpm	760rpm		
Tao (°C)	29-38	760rpm	760rpm	800rpm		
	≥38	800rpm				
Heatin	ig frequency(Hz) (09K)	<45 Hz	45-63Hz	≥63Hz		
Tao (℃)	≤10	760rpm	800rpm	850rpm		
	10-17	520rpm	760rpm	800rpm		
	≥17		520rpm			

7.1.4 Four way control

For the details of defrosting four-way valve control, see the defrosting process.

Four way working in other ways:


Under the mode of heating, open the four-way valve, when the compressor is not started or changed to non-heating mode, make sure the compressor is stoped for 2 minutes, and then close the four-way valve.

7.1.5 Protection function

7.1.5.1 TTC high temperature-preventing protection

Once the machine is started, it can run TTC(air-blowing temp) overheating protection of air-blowing, but air-blowing sensor malfunction must alarm after 4 minutes during which the compressor is started (during the course of self-detection, there's no such limitation)

Sensor detection methods: 100 times (one cycle of procedure run is one time, and about 5ms, detection method for each time: continuously sampling for 8 times, then order them and take the mean value of the middle 2 values), take the mean value.

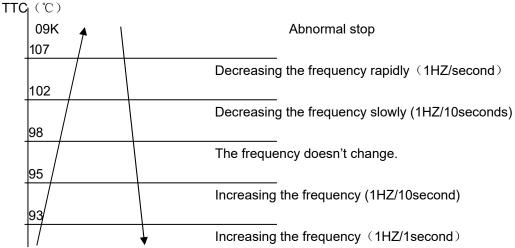


TTC>=110 $^{\circ}$ C lasts for 20 seconds. Overheating protection of air-blowing, alarm malfunction to the indoor, others don't last.

7.1.5.2 TC high temperature-preventing control of the indoor heating unit:

Tpg_indoor is the highest value of the effective indoor unit (start it and it is in accord with the running state). TC=indoor coil temp.

The indoor heat exchanger sensor tests the temperature of the indoor heat exchanger. If the temperature is higher than 63°C, decrease the rotate speed of the compressor and do the high temperature-preventing protection of the indoor heat exchanger; if the temperature of the indoor heat exchanger is lower than 45°C, recover to the normal control.

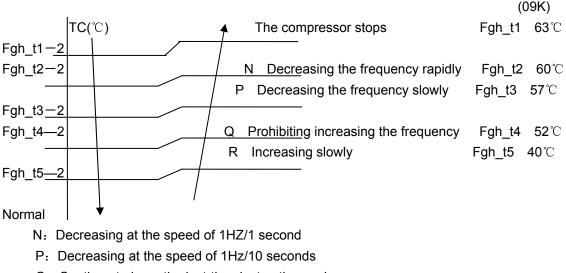

- Q: Continue to keep the last-time instruction cycle
- R: Increasing at the speed of 1Hz/10seconds
- Remarks: the outdoor unit

7.1.5.3 The control of preventing the over current of the compressor:

• During the starting process of the compressor, if the current of the compressor is greater than 10A for 3 seconds, stop the compressor and alarm, after 3 minutes, start it again, if such state appears 3 times in 20 minutes, stop the compressor and alarm, and confirm the malfunction. Then continue to run it only after the power is off.

• During the starting process of the compressor, if the AC current is greater than 9A, the frequency of the compressor decreases at the speed of 1HZ/second.

•During the starting process of the compressor, if the AC current is greater than 8A, the frequency of the compressor decreases at the speed of 0.1HZ/second.

•During the starting process of the compressor, if the AC current is greater than 7A, the frequency of the compressor increases at the prohibited speed.

• During the starting process of the compressor, if the AC current is greater than 6A, the frequency of the compressor increases at the speed of no faster than 0.1HZ/second.

7.1.5.4 The protection function of AC current:

During the starting process of the compressor, if the AC current is greater than 10A for 3 seconds, stop the compressor and alarm, after 3 minutes, start it again, if such state appears 3 times in 20 minutes, stop the compressor and alarm, and confirm the malfunction. Then continue to run it only after the the power is off.

During the starting process of the compressor, if the AC current is greater than 9A, the frequency of the compressor decreases at the speed of 1HZ/second.

During the starting process of the compressor, if the AC current is greater than 8A, the frequency of

the compressor decreases at the speed of 0.1HZ/second.

During the starting process of the compressor, if the AC current is greater than 7A, the frequency of the compressor increases at the prohibited speed.

During the starting process of the compressor, if the AC current is greater than 6A, the frequency of the compressor increases at the speed of no faster than 0.1HZ/second.

Remarks: when the outdoor temperature is high, there's compensation for AC current protection.


(1) When the outdoor environment temperature is higher than 40 $^\circ C$, AC current protection value decreases by 2A/1A(09K/12K).

(2) When the outdoor environment temperature is higher than 50 $^\circ C$, AC current protection value decreases by 3A/2A(09K/12K).

7.1.5.5 Anti-freezing protection of the indoor heat exchanger

When refrigerating/heating, prevent freezing.

Tpg_indoor is the minimum value of the effective indoor unit (start it and it is in accord with the running state).

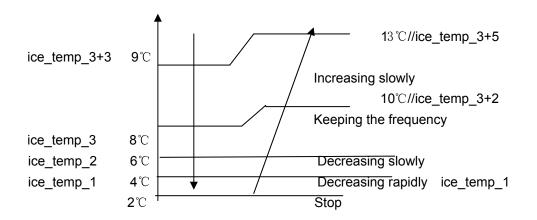

When Tpg_indoor \langle ice_temp_1, the frequency of the compressor decreases at the speed of 1HZ/1second.

When Tpg_indoor \langle ice_temp_2, the frequency of the compressor decreases at the speed of 1HZ/10seconds.

When Tpg_indoor begins to rise again, and ice_temp_2 \leq Tpg_indoor \leq ice_temp_3, the frequency of the compressor doesn't change.

When ice_temp_3 $\langle Tpg_indoor \langle ice_temp_3+3^{\circ}C \rangle$, the frequency of the compressor increases at the speed of 1HZ/10seconds.

For example, Tpg_indoor $\leq 0^{\circ}$ C, last for 2 minutes, and then the outdoor unit will stop, and report underload malfunction, but don't send malfunction report to the indoor.

The compressor stops for more than 3 minutes, Tpg_indoor> ice_temp_3+2 $^\circ\!C$, the compressor recovers.

7.1.5.6 The frequency limitation of modification rate

In the field which is controlled by high frequency, if the modification rate is not high enough, the control-driven chip will enter into weak magnetic control, this will help to relieve the problem of

modification rate. If during the course of weak magnetic control, the modification rate is still not high enough, enter into the control of decreasing frequency until the alarm of modification rate is relieved.

7.1.5.7 Temperature protection of the outdoor refrigerating coil

When the defrosting temperature and the sensor's temperature are higher than 68 $^{\circ}$ C, the frequency of the compressor decreases 1hz/10seconds. Keep the frequency until it decreases to the lowest frequency. When the temperatures are lower than 68 $^{\circ}$ C and higher than 62 $^{\circ}$ C, keep the frequency of the compressor. When the temperatures are lower than 62 $^{\circ}$ C, relieve the defrosting temperature protection.

7.2 Value of Thermistor

Ambient Sensor, Defrosting Sensor, Pipe sensor

25℃=10K Ω± 3%	B25℃/50℃=3700	K±3%			
Temp.(℃)	Max.(KΩ)	Normal(KΩ)	Min.(KΩ)	Tolerar	nce(℃)
-30	165.2170	147.9497	132.3678	-1.94	1.75
-29	155.5754	139.5600	125.0806	-1.93	1.74
-28	146.5609	131.7022	118.2434	-1.91	1.73
-27	138.1285	124.3392	111.8256	-1.89	1.71
-26	130.2371	117.4366	105.7989	-1.87	1.70
-25	122.8484	110.9627	100.1367	-1.85	1.69
-24	115.9272	104.8882	94.8149	-1.83	1.67
-23	109.4410	99.1858	89.8106	-1.81	1.66
-22	103.3598	93.8305	85.1031	-1.80	1.64
-21	97.6556	88.7989	80.6728	-1.78	1.63
-20	92.3028	84.0695	76.5017	-1.76	1.62
-19	87.2775	79.6222	72.5729	-1.74	1.60
-18	82.5577	75.4384	68.8710	-1.72	1.59
-17	78.1230	71.5010	65.3815	-1.70	1.57
-16	73.9543	67.7939	62.0907	-1.68	1.55
-15	70.0342	64.3023	58.9863	-1.66	1.54
-14	66.3463	61.0123	56.0565	-1.64	1.52
-13	62.8755	57.9110	53.2905	-1.62	1.51
-12	59.6076	54.9866	50.6781	-1.60	1.49
-11	56.5296	52.2278	48.2099	-1.58	1.47
-10	53.6294	49.6244	45.8771	-1.56	1.46
-9	50.8956	47.1666	43.6714	-1.54	1.44
-8	48.3178	44.8454	41.5851	-1.51	1.42
-7	45.8860	42.6525	39.6112	-1.49	1.40
-6	43.5912	40.5800	37.7429	-1.47	1.39
-5	41.4249	38.6207	35.9739	-1.45	1.37
-4	39.3792	36.7676	34.2983	-1.43	1.35
-3	37.4465	35.0144	32.7108	-1.41	1.33
-2	35.6202	33.3552	31.2062	-1.38	1.31

R25°C=10K Ω ±3% **B25**°C/50°C=3700K±3%

Domestic air conditioner

				Functions	and control
-1	33.8936	31.7844	29.7796	-1.36	1.29
0	32.2608	30.2968	28.4267	-1.34	1.28
1	30.7162	28.8875	27.1431	-1.32	1.26
2	29.2545	27.5519	25.9250	-1.29	1.24
3	27.8708	26.2858	24.7686	-1.27	1.22
4	26.5605	25.0851	23.6704	-1.25	1.20
5	25.3193	23.9462	22.6273	-1.23	1.18
6	24.1432	22.8656	21.6361	-1.20	1.16
7	23.0284	21.8398	20.6939	-1.18	1.14
8	21.9714	20.8659	19.7982	-1.15	1.12
9	20.9688	19.9409	18.9463	-1.13	1.09
10	20.0176	19.0621	18.1358	-1.11	1.07
11	19.1149	18.2270	17.3646	-1.08	1.05
12	18.2580	17.4331	16.6305	-1.06	1.03
13	17.4442	16.6782	15.9315	-1.03	1.01
14	16.6711	15.9601	15.2657	-1.01	0.99
15	15.9366	15.2770	14.6315	-0.98	0.96
16	15.2385	14.6268	14.0271	-0.96	0.94
17	14.5748	14.0079	13.4510	-0.93	0.92
18	13.9436	13.4185	12.9017	-0.91	0.90
19	13.3431	12.8572	12.3778	-0.88	0.87
20	12.7718	12.3223	11.8780	-0.86	0.85
21	12.2280	11.8126	11.4011	-0.83	0.83
22	11.7102	11.3267	10.9459	-0.81	0.80
23	11.2172	10.8634	10.5114	-0.78	0.78
24	10.7475	10.4216	10.0964	-0.75	0.75
25	10.3000	10.0000	9.7000	-0.75	0.75
26	9.8975	9.5974	9.2980	-0.76	0.76
27	9.5129	9.2132	8.9148	-0.80	0.80
28	9.1454	8.8465	8.5496	-0.84	0.83
29	8.7942	8.4964	8.2013	-0.87	0.86
30	8.4583	8.1621	7.8691	-0.91	0.90
31	8.1371	7.8428	7.5522	-0.95	0.93
32	7.8299	7.5377	7.2498	-0.98	0.97
33	7.5359	7.2461	6.9611	-1.02	1.00
34	7.2546	6.9673	6.6854	-1.06	1.04
35	6.9852	6.7008	6.4222	-1.10	1.07
36	6.7273	6.4459	6.1707	-1.13	1.11
37	6.4803	6.2021	5.9304	-1.17	1.14
38	6.2437	5.9687	5.7007	-1.21	1.18
39	6.0170	5.7454	5.4812	-1.25	1.22
40	5.7997	5.5316	5.2712	-1.29	1.25
41	5.5914	5.3269	5.0704	-1.33	1.29
42	5.3916	5.1308	4.8783	-1.37	1.33

				Functions	and control
43	5.2001	4.9430	4.6944	-1.41	1.36
44	5.0163	4.7630	4.5185	-1.45	1.40
45	4.8400	4.5905	4.3500	-1.49	1.44
46	4.6708	4.4252	4.1887	-1.53	1.47
47	4.5083	4.2666	4.0342	-1.57	1.51
48	4.3524	4.1145	3.8862	-1.61	1.55
49	4.2026	3.9686	3.7443	-1.65	1.59
50	4.0588	3.8287	3.6084	-1.70	1.62
51	3.9206	3.6943	3.4780	-1.74	1.66
52	3.7878	3.5654	3.3531	-1.78	1.70
53	3.6601	3.4416	3.2332	-1.82	1.74
54	3.5374	3.3227	3.1183	-1.87	1.78
55	3.4195	3.2085	3.0079	-1.91	1.82
56	3.3060	3.0989	2.9021	-1.95	1.85
57	3.1969	2.9935	2.8005	-2.00	1.89
58	3.0919	2.8922	2.7029	-2.04	1.93
59	2.9909	2.7948	2.6092	-2.08	1.97
60	2.8936	2.7012	2.5193	-2.13	2.01
61	2.8000	2.6112	2.4328	-2.17	2.05
62	2.7099	2.5246	2.3498	-2.22	2.09
63	2.6232	2.4413	2.2700	-2.26	2.13
64	2.5396	2.3611	2.1932	-2.31	2.17
65	2.4591	2.2840	2.1195	-2.36	2.21
66	2.3815	2.2098	2.0486	-2.40	2.25
67	2.3068	2.1383	1.9803	-2.45	2.29
68	2.2347	2.0695	1.9147	-2.49	2.34
69	2.1652	2.0032	1.8516	-2.54	2.38
70	2.0983	1.9393	1.7908	-2.59	2.42
71	2.0337	1.8778	1.7324	-2.63	2.46
72	1.9714	1.8186	1.6761	-2.68	2.50
73	1.9113	1.7614	1.6219	-2.73	2.54
74	1.8533	1.7064	1.5697	-2.78	2.58
75	1.7974	1.6533	1.5194	-2.83	2.63
76	1.7434	1.6021	1.4710	-2.88	2.67
77	1.6913	1.5528	1.4243	-2.92	2.71
78	1.6409	1.5051	1.3794	-2.97	2.75
79	1.5923	1.4592	1.3360	-3.02	2.80
80	1.5454	1.4149	1.2942	-3.07	2.84
81	1.5000	1.3721	1.2540	-3.12	2.88
82	1.4562	1.3308	1.2151	-3.17	2.93
83	1.4139	1.2910	1.1776	-3.22	2.97
84	1.3730	1.2525	1.1415	-3.27	3.01
85	1.3335	1.2153	1.1066	-3.32	3.06
86	1.2953	1.1794	1.0730	-3.38	3.10

				T unctions	s and control
87	1.2583	1.1448	1.0405	-3.43	3.15
88	1.2226	1.1113	1.0092	-3.48	3.19
89	1.1880	1.0789	0.9789	-3.53	3.24
90	1.1546	1.0476	0.9497	-3.58	3.28
91	1.1223	1.0174	0.9215	-3.64	3.33
92	1.0910	0.9882	0.8942	-3.69	3.37
93	1.0607	0.9599	0.8679	-3.74	3.42
94	1.0314	0.9326	0.8424	-3.80	3.46
95	1.0030	0.9061	0.8179	-3.85	3.51
96	0.9756	0.8806	0.7941	-3.90	3.55
97	0.9490	0.8558	0.7711	-3.96	3.60
98	0.9232	0.8319	0.7489	-4.01	3.64
99	0.8983	0.8088	0.7275	-4.07	3.69
100	0.8741	0.7863	0.7067	-4.12	3.74
101	0.8507	0.7646	0.6867	-4.18	3.78
102	0.8281	0.7436	0.6672	-4.23	3.83
103	0.8061	0.7233	0.6484	-4.29	3.88
104	0.7848	0.7036	0.6303	-4.34	3.92
105	0.7641	0.6845	0.6127	-4.40	3.97
106	0.7441	0.6661	0.5957	-4.46	4.02
107	0.7247	0.6482	0.5792	-4.51	4.07
108	0.7059	0.6308	0.5632	-4.57	4.12
109	0.6877	0.6140	0.5478	-4.63	4.16
110	0.6700	0.5977	0.5328	-4.69	4.21
111	0.6528	0.5820	0.5183	-4.74	4.26
112	0.6361	0.5667	0.5043	-4.80	4.31
113	0.6200	0.5518	0.4907	-4.86	4.36
114	0.6043	0.5374	0.4775	-4.92	4.41
115	0.5891	0.5235	0.4648	-4.98	4.45
116	0.5743	0.5100	0.4524	-5.04	4.50
117	0.5600	0.4968	0.4404	-5.10	4.55
118	0.5460	0.4841	0.4288	-5.16	4.60
119	0.5325	0.4717	0.4175	-5.22	4.65
120	0.5194	0.4597	0.4066	-5.28	4.70

Discharging Sensor

R80°C=50K $\Omega\pm$ 3%

B25/80℃=4450K±3%						
Temp.(($^{\circ}$ C))Max.(K Ω)Normal(K Ω)Min.(K Ω)Tolerance($^{\circ}$ C)					ice(℃)	
-30	14646.0505	12061.7438	9924.4999	-2.96	2.45	
-29	13654.1707	11267.8730	9290.2526	-2.95	2.44	
-28	12735.8378	10531.3695	8700.6388	-2.93	2.44	
-27	11885.1336	9847.7240	8152.2338	-2.92	2.43	

Domestic air conditioner


				Functions	s and control
-26	11096.6531	9212.8101	7641.8972	-2.91	2.42
-25	10365.4565	8622.8491	7166.7474	-2.90	2.42
-24	9687.0270	8074.3787	6724.1389	-2.88	2.41
-23	9057.2314	7564.2244	6311.6413	-2.87	2.41
-22	8472.2852	7089.4741	5927.0206	-2.86	2.40
-21	7928.7217	6647.4547	5568.2222	-2.84	2.39
-20	7423.3626	6235.7109	5233.3554	-2.83	2.39
-19	6953.2930	5851.9864	4920.6791	-2.82	2.38
-18	6515.8375	5494.2064	4628.5894	-2.80	2.37
-17	6108.5393	5160.4621	4355.6078	-2.79	2.37
-16	5729.1413	4848.9963	4100.3708	-2.77	2.36
-15	5375.5683	4558.1906	3861.6201	-2.76	2.35
-14	5045.9114	4286.5535	3638.1938	-2.75	2.34
-13	4738.4141	4032.7098	3429.0191	-2.73	2.34
-12	4451.4586	3795.3910	3233.1039	-2.72	2.33
-11	4183.5548	3573.4260	3049.5312	-2.70	2.32
-10	3933.3289	3365.7336	2877.4527	-2.69	2.31
-9	3699.5139	3171.3148	2716.0828	-2.67	2.30
-8	3480.9407	2989.2460	2564.6945	-2.66	2.29
-7	3276.5302	2818.6731	2422.6139	-2.64	2.28
-6	3085.2854	2658.8058	2289.2164	-2.63	2.28
-5	2906.2851	2508.9126	2163.9230	-2.61	2.27
-4	2738.6777	2368.3158	2046.1961	-2.60	2.26
-3	2581.6752	2236.3876	1935.5371	-2.58	2.25
-2	2434.5487	2112.5459	1831.4826	-2.56	2.24
-1	2296.6230	1996.2509	1733.6024	-2.55	2.23
0	2167.2730	1887.0018	1641.4966	-2.53	2.22
1	2045.9191	1784.3336	1554.7931	-2.52	2.21
2	1932.0242	1687.8144	1473.1460	-2.50	2.20
3	1825.0899	1597.0431	1396.2333	-2.48	2.19
4	1724.6540	1511.6468	1323.7551	-2.47	2.17
5	1630.2870	1431.2787	1255.4324	-2.45	2.16
6	1541.5904	1355.6163	1191.0048	-2.43	2.15
7	1458.1938	1284.3593	1130.2298	-2.41	2.14
8	1379.7528	1217.2282	1072.8813	-2.40	2.13
9	1305.9472	1153.9626	1018.7481	-2.38	2.12
10	1236.4792	1094.3200	967.6334	-2.36	2.11
11	1171.0715	1038.0743	919.3533	-2.35	2.09
12	1109.4661	985.0146	873.7359	-2.33	2.08
13	1051.4226	934.9440	830.6210	-2.31	2.07
14	996.7169	887.6792	789.8583	-2.29	2.06
15	945.1404	843.0486	751.3077	-2.27	2.04
16	896.4981	800.8922	714.8380	-2.26	2.03
17	850.6086	761.0603	680.3265	-2.24	2.02

				Functions	s and control
18	807.3024	723.4134	647.6580	-2.22	2.00
19	766.4212	687.8205	616.7252	-2.20	1.99
20	727.8172	654.1596	587.4271	-2.18	1.98
21	691.3524	622.3161	559.6694	-2.16	1.96
22	656.8979	592.1831	533.3634	-2.14	1.95
23	624.3328	563.6604	508.4261	-2.12	1.93
24	593.5446	536.6540	484.7796	-2.10	1.92
25	564.4275	511.0760	462.3510	-2.09	1.90
26	536.9865	486.9352	441.1516	-2.07	1.89
27	511.0105	464.0500	421.0258	-2.05	1.87
28	486.4151	442.3499	401.9146	-2.03	1.86
29	463.1208	421.7683	383.7626	-2.01	1.84
30	441.0535	402.2430	366.5175	-1.99	1.83
31	420.1431	383.7151	350.1301	-1.97	1.81
32	400.3242	366.1295	334.5542	-1.95	1.80
33	381.5350	349.4341	319.7460	-1.93	1.78
34	363.7176	333.5801	305.6645	-1.90	1.76
35	346.8176	318.5216	292.2709	-1.88	1.75
36	330.7839	304.2151	279.5286	-1.86	1.73
37	315.5682	290.6199	267.4031	-1.84	1.71
38	301.1254	277.6976	255.8620	-1.82	1.70
39	287.4128	265.4119	244.8745	-1.80	1.68
40	274.3905	253.7288	234.4118	-1.78	1.66
41	262.0206	242.6161	224.4465	-1.76	1.64
42	250.2676	232.0436	214.9529	-1.74	1.63
43	239.0983	221.9825	205.9065	-1.71	1.61
44	228.4809	212.4060	197.2844	-1.69	1.59
45	218.3860	203.2887	189.0648	-1.67	1.57
46	208.7855	194.6066	181.2273	-1.65	1.55
47	199.6531	186.3369	173.7524	-1.63	1.54
48	190.9639	178.4584	166.6217	-1.60	1.52
49	182.6945	170.9508	159.8181	-1.58	1.50
50	174.8228	163.7951	153.3249	-1.56	1.48
51	167.3280	156.9733	147.1268	-1.53	1.46
52	160.1904	150.4683	141.2090	-1.51	1.44
53	153.3914	144.2641	135.5577	-1.49	1.42
54	146.9136	138.3454	130.1598	-1.47	1.40
55	140.7403	132.6980	125.0027	-1.44	1.38
56	134.8559	127.3081	120.0746	-1.42	1.36
57	129.2457	122.1630	115.3645	-1.40	1.34
58	123.8956	117.2504	110.8618	-1.37	1.32
59	118.7926	112.5589	106.5564	-1.35	1.30
60	113.9241	108.0776	102.4388	-1.32	1.28
61	109.2784	103.7961	98.5000	-1.30	1.26


62 63	104.8443	99.7046	94.7315	-1.28	1.00
63			54.7515	-1.20	1.23
	100.6112	95.7939	91.1253	-1.25	1.21
64	96.5692	92.0553	87.6735	-1.23	1.19
65	92.7088	88.4805	84.3690	-1.20	1.17
66	89.0211	85.0614	81.2048	-1.18	1.15
67	85.4976	81.7908	78.1744	-1.15	1.12
68	82.1303	78.6615	75.2715	-1.13	1.10
69	78.9116	75.6668	72.4902	-1.10	1.08
70	75.8343	72.8004	69.8249	-1.08	1.06
71	72.8916	70.0561	67.2703	-1.05	1.03
72	70.0770	67.4283	64.8213	-1.03	1.01
73	67.3844	64.9115	62.4731	-1.00	0.99
74	64.8080	62.5006	60.2211	-0.98	0.96
75	62.3423	60.1906	58.0609	-0.95	0.94
76	59.9821	57.9770	55.9885	-0.92	0.92
77	57.7223	55.8552	53.9998	-0.90	0.89
78	55.5583	53.8210	52.0912	-0.87	0.87
79	53.4856	51.8706	50.2591	-0.85	0.84
80	51.5000	50.0000	48.5000	-0.85	0.84
81	49.7063	48.2057	46.7083	-0.85	0.85
82	47.9835	46.4842	44.9911	-0.89	0.89
83	46.3286	44.8323	43.3452	-0.93	0.92
84	44.7385	43.2468	41.7672	-0.96	0.95
85	43.2105	41.7248	40.2540	-1.00	0.99
86	41.7386	40.2604	38.7996	-1.03	1.02
87	40.3241	38.8545	37.4048	-1.07	1.06
88	38.9643	37.5045	36.0668	-1.11	1.09
89	37.6569	36.2078	34.7831	-1.14	1.13
90	36.3996	34.9622	33.5513	-1.18	1.16
91	35.1903	33.7653	32.3689	-1.22	1.19
92	34.0269	32.6151	31.2338	-1.26	1.23
93	32.9075	31.5096	30.1438	-1.30	1.27
94	31.8302	30.4467	29.0970	-1.33	1.30
95	30.7933	29.4246	28.0915	-1.37	1.34
96	29.7950	28.4417	27.1254	-1.41	1.37
97	28.8337	27.4961	26.1970	-1.45	1.41
98	27.9078	26.5864	25.3048	-1.49	1.44
99	27.0160	25.7110	24.4470	-1.53	1.48
100	26.1569	24.8685	23.6222	-1.57	1.52
101	25.3290	24.0574	22.8291	-1.61	1.55
102	24.5311	23.2765	22.0662	-1.65	1.59
103	23.7620	22.5245	21.3323	-1.69	1.63
104	23.0205	21.8002	20.6261	-1.73	1.66
105	22.3055	21.1025	19.9465	-1.77	1.70

				Functions	s and control
106	21.6159	20.4303	19.2924	-1.81	1.74
107	20.9508	19.7825	18.6626	-1.85	1.77
108	20.3091	19.1582	18.0563	-1.89	1.81
109	19.6899	18.5564	17.4723	-1.93	1.85
110	19.0924	17.9761	16.9098	-1.98	1.89
111	18.5157	17.4166	16.3680	-2.02	1.93
112	17.9590	16.8769	15.8458	-2.06	1.96
113	17.4214	16.3564	15.3427	-2.10	2.00
114	16.9023	15.8542	14.8577	-2.15	2.04
115	16.4010	15.3696	14.3902	-2.19	2.08
116	15.9167	14.9020	13.9394	-2.23	2.12
117	15.4489	14.4506	13.5047	-2.27	2.16
118	14.9968	14.0149	13.0855	-2.32	2.19
119	14.5599	13.5942	12.6811	-2.36	2.23
120	14.1376	13.1879	12.2909	-2.41	2.27
121	13.7294	12.7955	11.9144	-2.45	2.31
122	13.3347	12.4165	11.5510	-2.50	2.35
123	12.9531	12.0503	11.2003	-2.54	2.39
124	12.5840	11.6965	10.8617	-2.58	2.43
125	12.2270	11.3545	10.5348	-2.63	2.47
126	11.8817	11.0240	10.2191	-2.68	2.51
127	11.5475	10.7046	9.9142	-2.72	2.55
128	11.2242	10.3957	9.6197	-2.77	2.59
129	10.9112	10.0970	9.3352	-2.81	2.63
130	10.6084	9.8082	9.0602	-2.86	2.67
131	10.3151	9.5288	8.7945	-2.91	2.71
132	10.0312	9.2586	8.5378	-2.95	2.75
133	9.7563	8.9971	8.2895	-3.00	2.80
134	9.4901	8.7441	8.0495	-3.05	2.84
135	9.2322	8.4993	7.8175	-3.09	2.88
136	8.9824	8.2623	7.5931	-3.14	2.92
137	8.7404	8.0329	7.3760	-3.19	2.96
138	8.5059	7.8108	7.1660	-3.24	3.00
139	8.2787	7.5958	6.9629	-3.29	3.04
140	8.0584	7.3875	6.7664	-3.33	3.09

8.Dimensional drawings

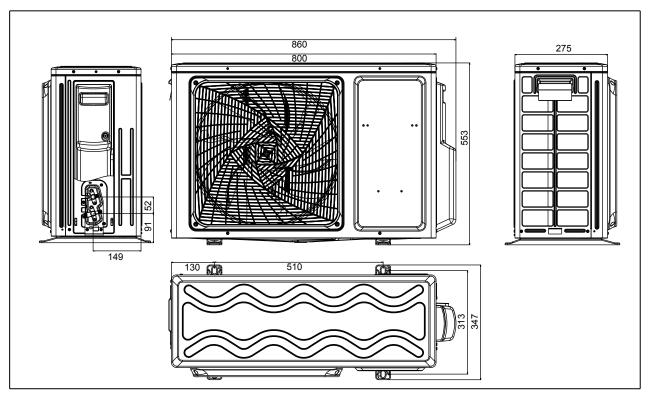

9.Center of graviţy

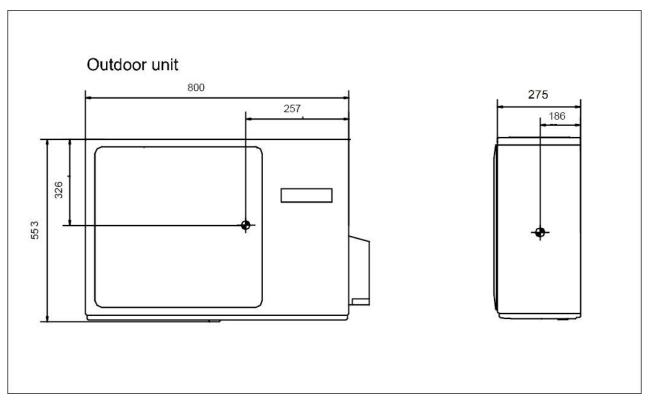

10 Service Diagnosis

10.1 Caution for Diagnosis

The operation lamp flashes when any of the following errors is detected.

1. When a protection device of the indoor or outdoor unit is activated or when the thermistor malfunctions, disabling equipment operation.

2. When a signal transmission error occurs between the indoor and outdoor units. In either case, conduct the diagnostic procedure described in the following pages.

Parameter of primary electronic appliance


name	parameter	picture
Compressor	Power source input to inverter Rated voltage:220V Rated frequency: 50HZ Phase:1phase	
Fan motor	Rated voltage:310V Rated current:0.5A MAX Rated output:25W	
Reactor	Rated current:15A Rated frequency: 50HZ Rated inductance:5.2mH	
4-way valve	Rated voltage:240V Rated current:0.1A Rated frequency: 50/60HZ	

10.2 Problem Symptoms and Measures

Symptom	Check Item	Details of Measure
None of the units	Check the power supply.	Check to make sure that the rated voltage is supplied.
operates	Check the indoor PCB	Check to make sure that the indoor PCB is broken
Operation sometimes stops.	Check the power supply.	A power failure of 2 to 10 cycles can stop air conditioner operation.
Equipment operates but does not cool, or does not heat (only for heat pump)	Check for faulty operation of the electronic expansion valve.	Set the units to cooling operation, and compare the temperatures of the liquid side connection pipes of the connection section among rooms to check the opening and closing operation of the electronic expansion valves of the individual units.
	Diagnosis by service port pressure and operating current.	Check for insufficient gas.
Large operating noise and vibrations	Check the installation condition.	Check to make sure that the required spaces for installation (specified in the Technical Guide, etc.) are provided.

10.3 Error Codes and Description indoor display


			de indica					
	Ir	ndoor displaying p	panel code indication Only For 498 and		Outdoor		Referenc	
	Other display		498A display (Red/Green Time Run		(LED1 flash times)	fault description	e Page	
muoor		1	□On★F	lash	■Off)	,	Communication fault between	
and Outdoo	E7	Directly display	-		*	15	indoor and outdoor units	Page.42
<u>.</u>	E1	Directly display	*			/	Indoor temperature sensor failure	Page.32
Indoor	E2	Directly display	*			1	Indoor coil sensor failure	Page.32
Malfunc	E4	Directly display	*		*	1	Indoor eeprom failure	Page.33
tion		Directly display			*	1	Indoor fan failure	Page.34
		Trouble record			*	22	Internal unit antifreeze protection	Page.
		Trouble record			*	21	Internal unit overload	Page.45
		Directly display		*		1	Eeprom failure	Page.33
	F1	Directly display		$\overline{\star}$	*	2	IPM failure	Page.37
		Directly display	*	*		3	AC current overcurrent protection	
	F3	Directly display		*		4	Communication error between module board and main PCB board.	Page.39
		Trouble record		*		5	High pressure protection	Page.45
		Trouble record		*		6	Power over/under voltage protection	Page.40
		Directly display		*		7	Compressor stall / press instantaneous stop	Page.40
		Directly display		*		8	Compressor discarging temperature protection	Page.41
	F8	Trouble record		*		9	Abnormal of DC motor	Page.36
Outdoo	F21	Directly display			*	10	Abnormal of piping sensor	Page.32
r Malfunc		Directly display		*		12	Abnormal of outdoor ambient sensor	Page.32
tion	F25	Directly display	*			13	Abnormal of compressor discharge sensor	Page.32
		Trouble record		★		16	Lack of refrigerant	Page.
	F14	Trouble record		★		17	4-way valve reverse failure	Page.
	F11	Directly display		★		18	Compressor jam (only for spdu)	Page.44
	F28	Directly display		*		19	Module PWM select circuit error	Page.44
	F2	Trouble record		*		24	Instantaneous over-current protection of the compressor	Page.38
	F23	Trouble record		*		25	Compressor U-phase overcurrent Compressor V-phase overcurrent Compressor W-phase overcurrent	Page.38
	F24	Trouble record	*		*	27	CT disconnection	Page.
		Trouble record		/		37	Outdoor coil protection	Page.
		Trouble record		*		38	Compressor driver board failure	Page.
	F43	/				46	Model matching abnormality	Page.

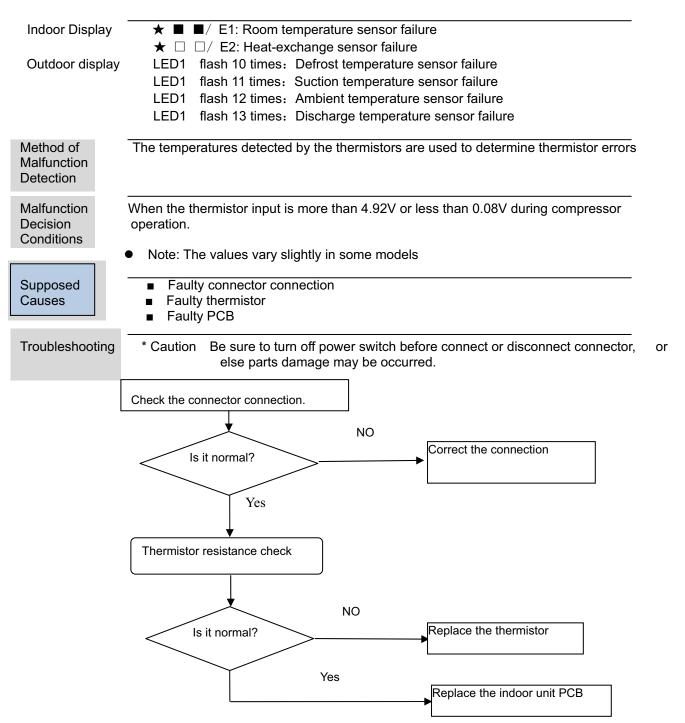

10.3.1 Thermistor or Related Abnormality

Thermistor resistance check method:


Remove the connector of the thermistor on the PCB, and measure the resistance of thermistor using tester. The relationship between normal temperature and resistance is shown in the value of indoor thermistor.



10.3.2 EEPROM abnormal


Indoor Display Indoor display	 ★ □ ★/ E4: Indoor EEPROM error ■ ★ ■/ F12: Outdoor EEPROM error; Outdoor LED1 flash 1 times
Method of Malfunction	The Data detected by the EEPROM are used to determine MCU
Detection Malfunction	When the data of EEPROM is error or the EEPROM is damaged
Decision Conditions	
Supposed Causes	 Faulty EEPROM data Faulty EEPROM Faulty PCB
Troubleshooting	* Caution Be sure to turn off power switch before connect or disconnect connector, or parts damage may be occurred.
	Replace the indoor or outdoor mainboard.

10.3.3 Indoor DC fan motor malfunction

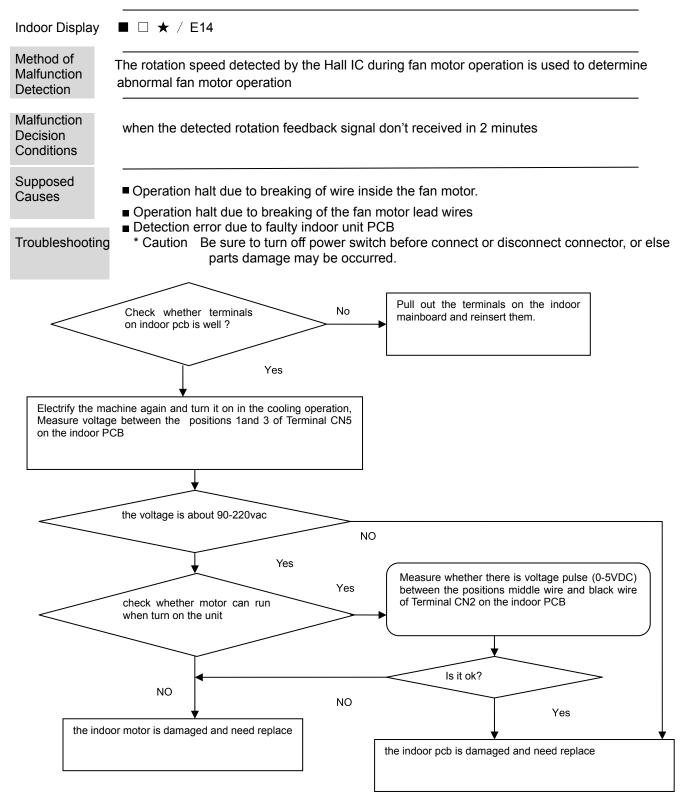


10.3.4 Outdoor DC fan motor fault


Outdoor display	\blacksquare \bigstar \Box / F8 LED1 flash 9 times
Method of	DC fan motor is detected by checking the fan running condition and so on
Malfunction Detection	
Malfunction Decision Conditions	when the data of EEPROM is error or the EEPROM is damaged
Supposed Causes	DC fan motor protection dues to the DC fan motor faulty
	fan motor protection dues to faulty PCB
Troubleshooting	* Caution Be sure to turn off power switch before connect or disconnect connector, or parts damage may be occurred.

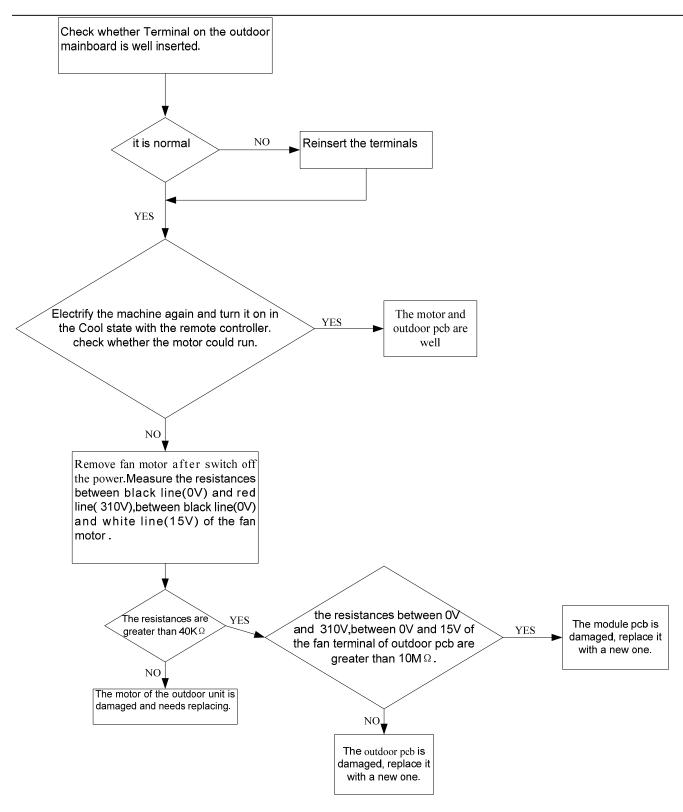

10.3.5 IPM protection

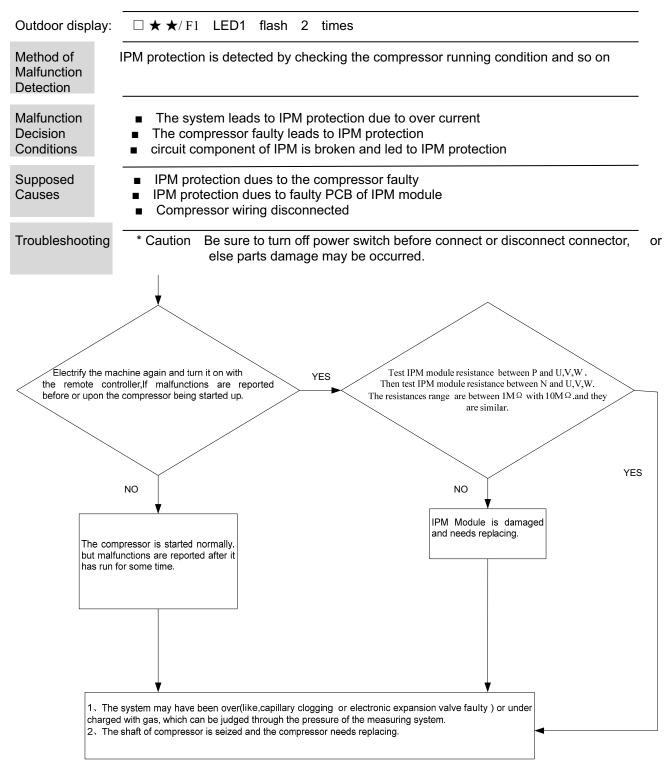


10.3.6 Over-current of the compressor

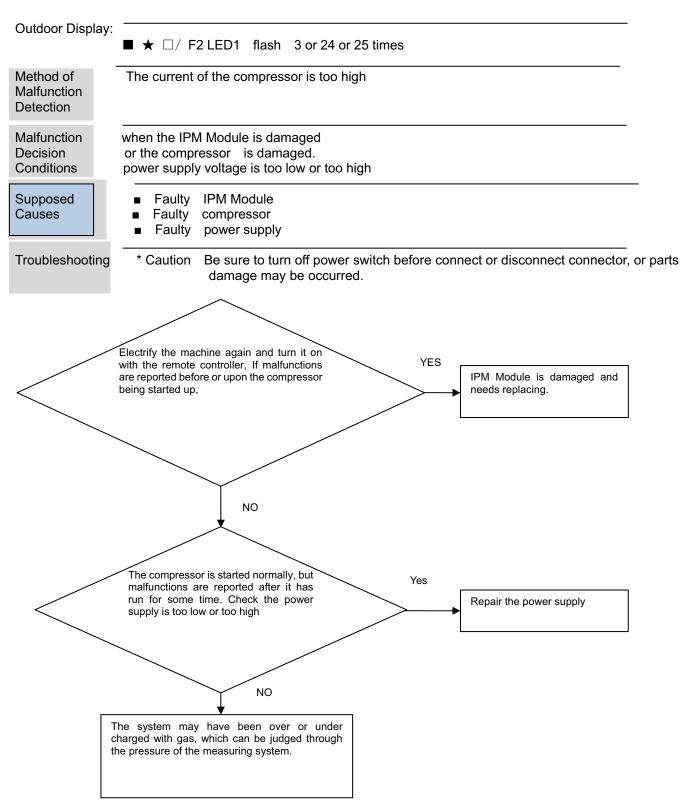


10.3.7 The communication fault between IPM and outdoor PCB


Outdoor display: ■ ★ ■/ F3 LED1 flash 4 times
Method of Malfunction Detection
 Malfunction The outdoor PCB broken leads to communication fault The IPM module broken leads to communication fault
Supposed The outdoor PCB is broken The IPM module is broken Communication wiring disconnected
Troubleshooting * Caution Be sure to turn off power switch before connect or disconnect connector, or else parts damage may be occurred.
 Check whether Terminal CN23 and CN24 on the outdoor mainboard CN10 and CN11 on IPM module Check whether the connected wire between IPM and outdoor
NO Are they good?
Malfunction unsolved
Electrify the machine again and turn it on, Check whether the voltage between 1 and 2 of Terminal CN23 is about DC5V, Check whether the voltage between2 Replace the outdoor IPM module
and 3 of Terminal CN23 is about DC15V, with a new one.
NO
Replace the outdoor mainboard with a new one

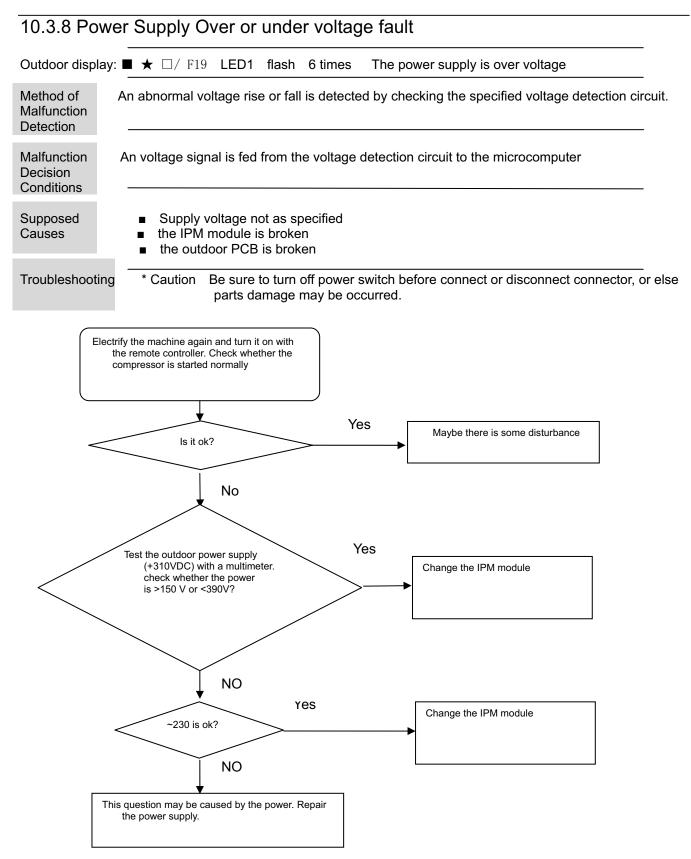


10.3.9 Overheat Protection For Discharge Temperature

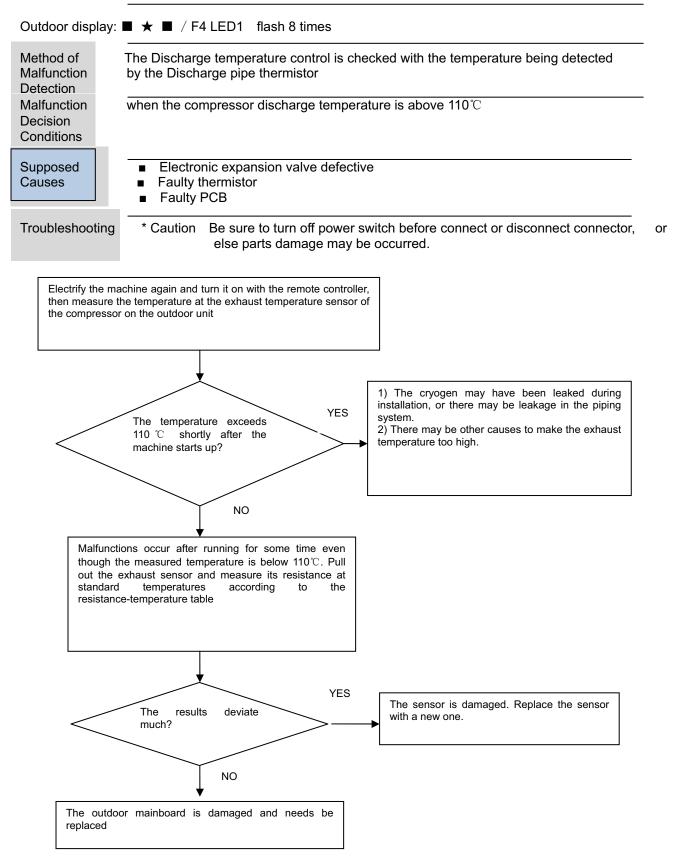


10.3.10 The communication fault between indoor and outdoor

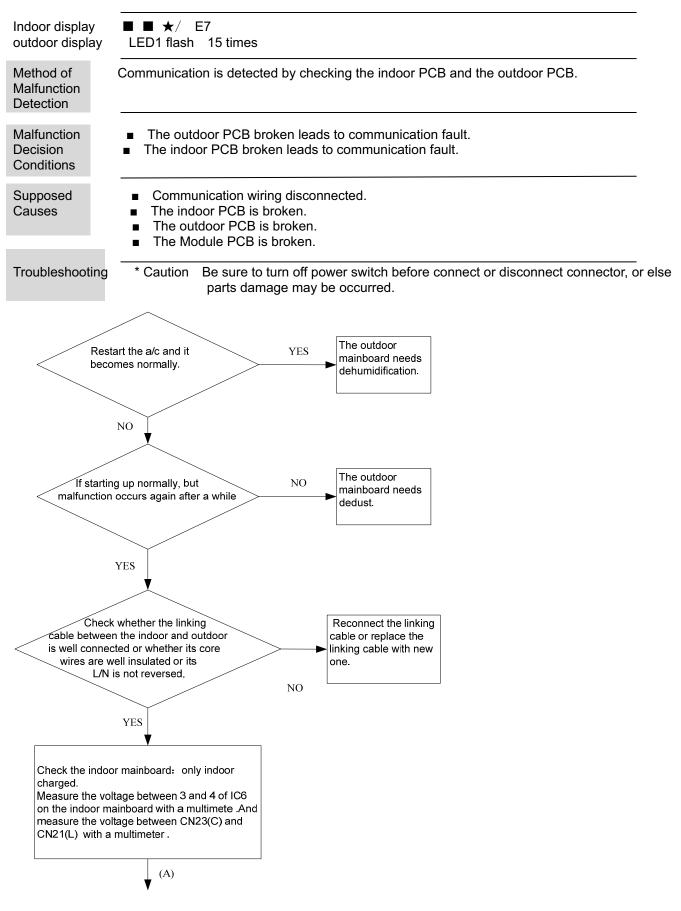


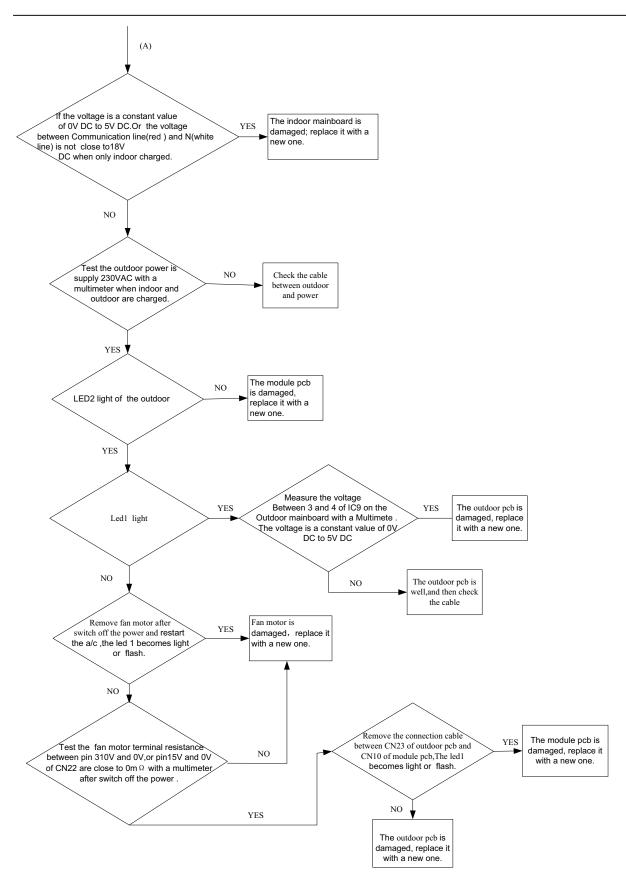

10.3.11 Loss of synchronism detection Inverter side current detection is abnormal

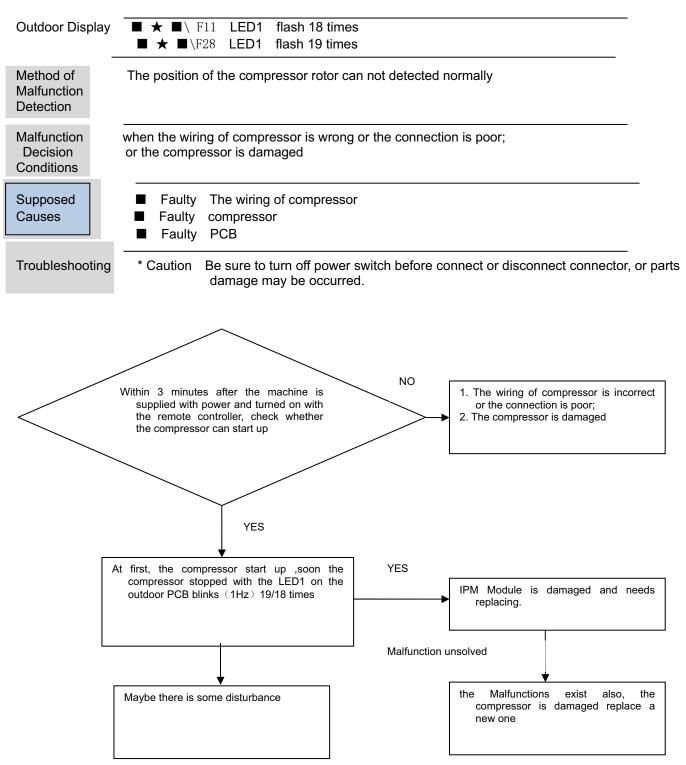


10.3.12 High work-intense protection

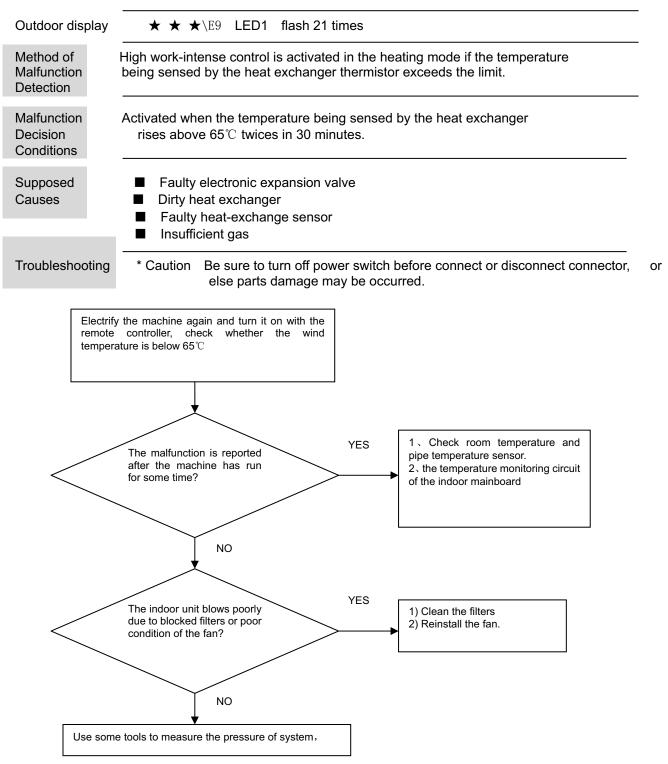

11.Performence and cerves diagrams


	performance curves											
cooling value-temerature table												
indoor temp.												
DB/WB	-20 ℃	-10 ℃	0 ℃	8 ℃	15 ℃	20 ℃	25 ℃	30 ℃	35 ℃	38 ℃	40 ℃	43 ℃
21/15℃	1709	1767	1876	2004	1923	1911	1767	2237	2401	2388	2312	2150
24/16 ℃	1793	1854	2021	2064	2024	1991	1858	2347	2546	2486	2363	2248
27/19℃	1966	2122	2206	2335	2293	2223	2120	2584	2839	2743	2710	2461
30/22 ℃	2080	2210	2340	2444	2392	2340	2210	2730	2990	2912	2808	2626
32/23 ℃	2203	2327	2444	2596	2533	2492	2359	2849	3222	3116	2962	2775
35/24 ℃	2252	2411	2593	2688	2633	2601	2452	2969	3256	3232	3043	2936

11.1 Cooling capacity-temperature curves

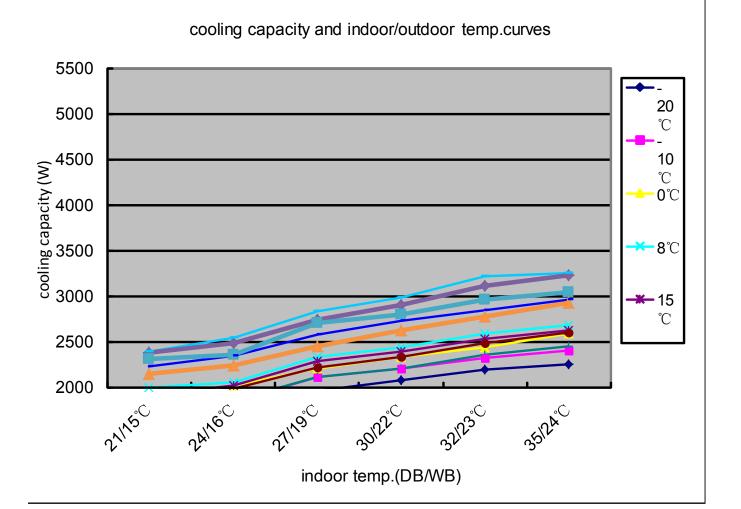


11.2 Cooling power consumption value- temperature curves

performance curves												
power consumption value-temp.table												
indoor temp.	indoor temp.											
DB/WB	-20 ℃	-10 ℃	0 ℃	8 ℃	15 ℃	20 ℃	25 ℃	30 ℃	35 ℃	38 ℃	40 ℃	43 ℃
21/15 ℃	371	464	548	630	631	603	301	417	547	657	772	801
24/16 ℃	390	489	572	645	638	629	312	431	554	689	779	828
27/19 ℃	445	542	628	710	685	670	334	476	617	717	850	929
30/22 ℃	462	567	669	719	704	688	345	488	623	743	878	938
32/23 ℃	497	600	701	729	727	710	366	514	658	825	920	1010
35/24 ℃	510	619	724	759	732	717	378	543	682	842	951	1032

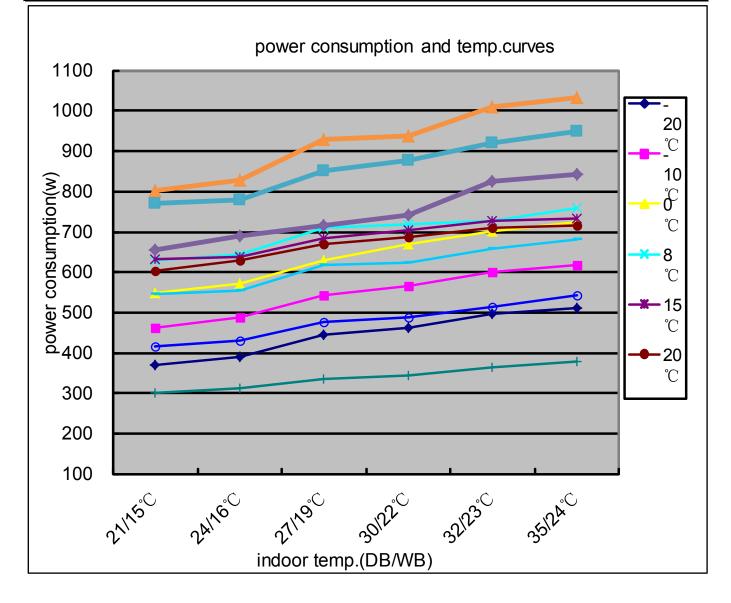


11.3 Cooling discharge pressure curves

	performance curves							
	cooling discharge pressure.table							
outdoor temp.indoor temp.(humidity 46%)indoor temp.								
DB/WB	21/15 ℃	27/19 ℃	35/24 ℃					
-20 ℃	1254	1289	1339					
-10 ℃	1383	1420	1493					
0 °C	1506	1578	1660					
8 °C	1658	1710	1793					
15 ℃	1759	1841	1957					
20 °C	1955	2025	2136					
25 ℃	2088	2157	2256					
30 ℃	2218	2341	2444					
35 ℃	2370	2499	2598					
38 ℃	2548	2683	2806					
40 ℃	2884	3025	3142					
43 ℃	3308	3419	3573					

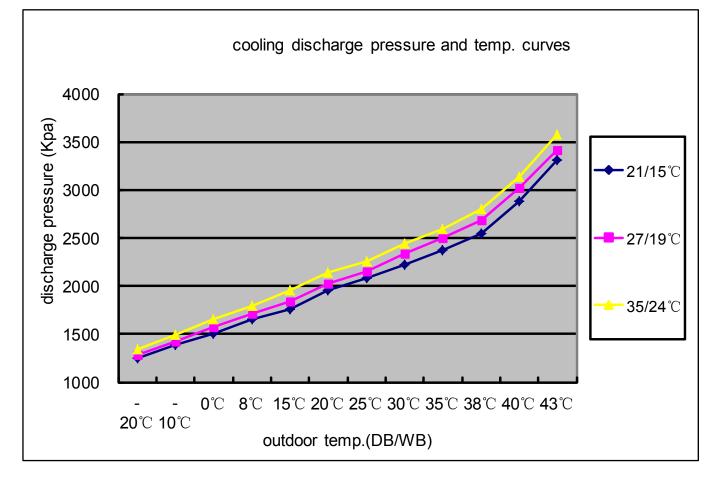


11.4 Cooling suction pressure curves

	cooling suctio	on pressure.table					
outdoor temp. (humidity 46%) indoor temp.							
DB/WB	21/15 ℃	27/19 ℃	35/24 ℃				
-20 °C	618	761	875				
-10 ℃	650	801	922				
0 °C	677	835	960				
8 °C	698	860	990				
15 ℃	713	878	1010				
20 ℃	720	887	1020				
25 ℃	758	896	1041				
30 ℃	798	943	1051				
35 ℃	840	953	1107				
38 ℃	884	982	1129				
40 ℃	972	1080	1242				
43 ℃	1069	1167	1354				

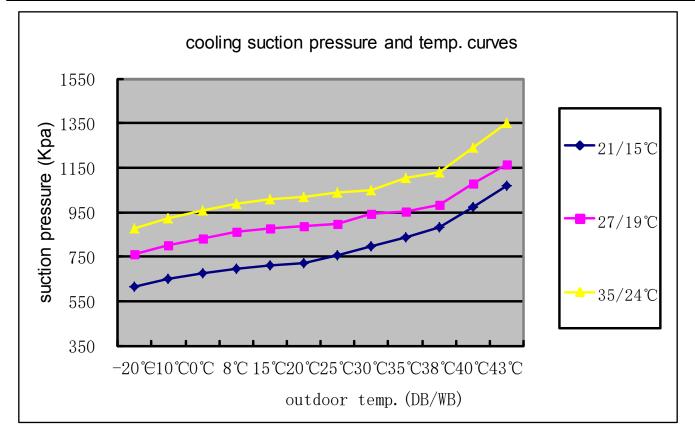

11.5 Heating capacity-temperature curves


	performance curves							
	heating capacity and indoor/outdoor temp.table							
outdoor temp.	outdoor temp. indoor temp.(humidity 46%)							
DB/WB	10 ℃	20 ℃	27 °C					
-20 ℃	2022	1866	1618					
-15 ℃	2460	2292	2022					
-10 ℃	2797	2558	2359					
-7/-8 ℃	3438	3117	2897					
2/1 ℃	3675	3243	2941					
7/6 ℃	3577	3303	2939					
12/11 ℃	3493	3146	2572					
18/16 ℃	3202	3051	2406					
24/20 ℃	3002	2761	2166					

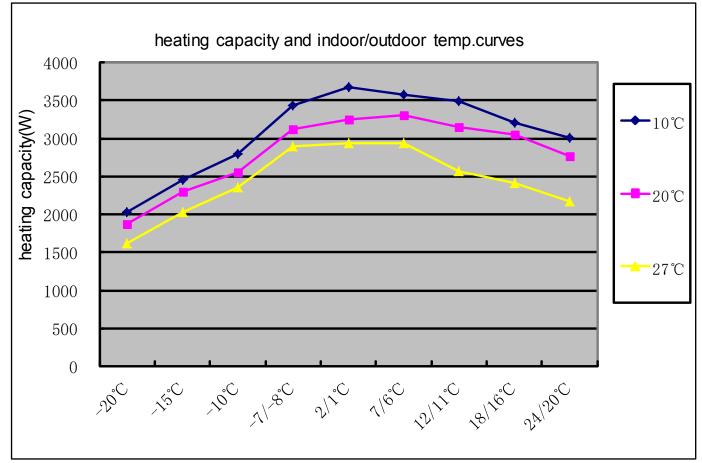

outdoor temp.(DB/WB)


11.6 Heating power consumption value- temperature curves

	performance curves							
	power consumption value-temp.table							
outdoor temp. indoor temp.(humidity 46%)								
DB/WB	10°C 20°C 27°C							
-20 °C	661	777	824					
-15℃	737	819	868					
-10°C	853	888	933					
-7/-8° ℃	955	974	1023					
2/1℃	981	1001	1051					
7/6℃	967	1007	1057					
12/11℃	861	925	1018					
18/16℃	723	803	883					
24/20 °C	565	627	690					

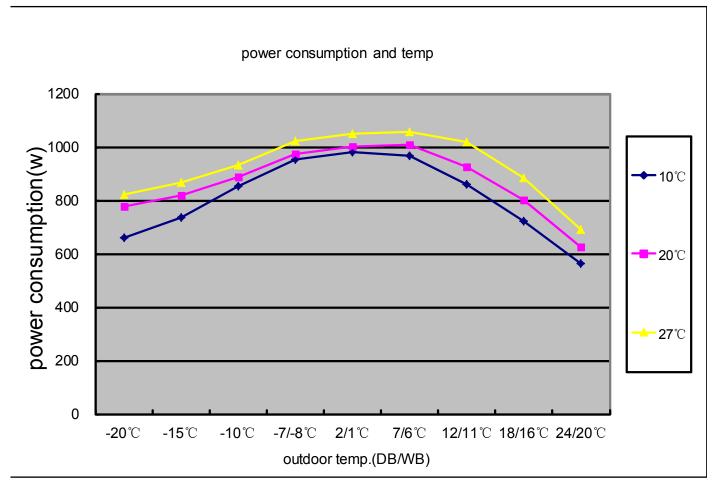


11.7 Heating discharge pressure curves

	performance curves							
	heating discharge pressure.table							
outdoor temp	indoor temp.							
DB/WB	10 ℃	20 ℃	27 ℃					
-20 ℃	2259	2394	2452					
-15℃	2466	2582	2713					
-10 ℃	2796	2975	3145					
-7/-8 ℃	3038	3249	3327					
2/1 ℃	3276	3523	3657					
7/6 ℃	3235	3420	3551					
12/11 ℃	3083	3249	3324					
18/16 ℃	2940	3054	3137					
24/20 ℃	2498	2596	2708					

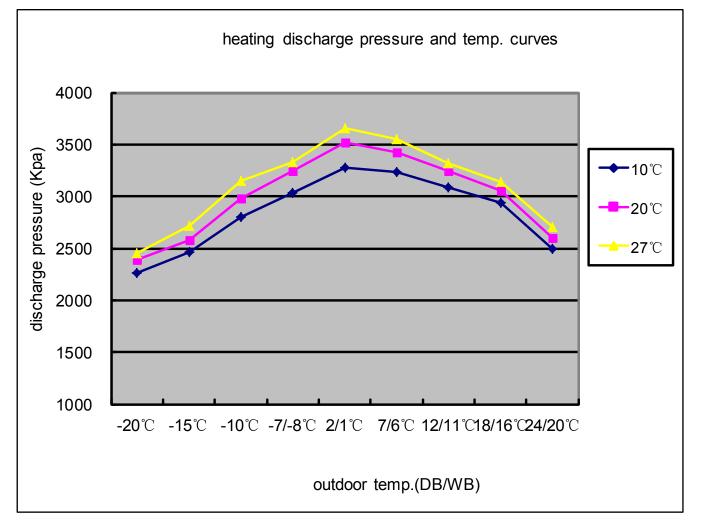



11.8 Heating suction pressure curves

	performance curves heating suction pressure.table							
outdoor temp indoor temp.								
DB/WB	10 ℃	20 °C	27 °C					
-20 ℃	263	302	322					
-15 ℃	347	386	406					
-10 ℃	400	429	449					
-7/-8 ℃	494	533	553					
2/1 ℃	613	652	672					
7/6 ℃	746	785	805					
12/11 ℃	847	886	906					
18/16 ℃	1014	1053	1073					
24/20 ℃	1200	1239	1259					

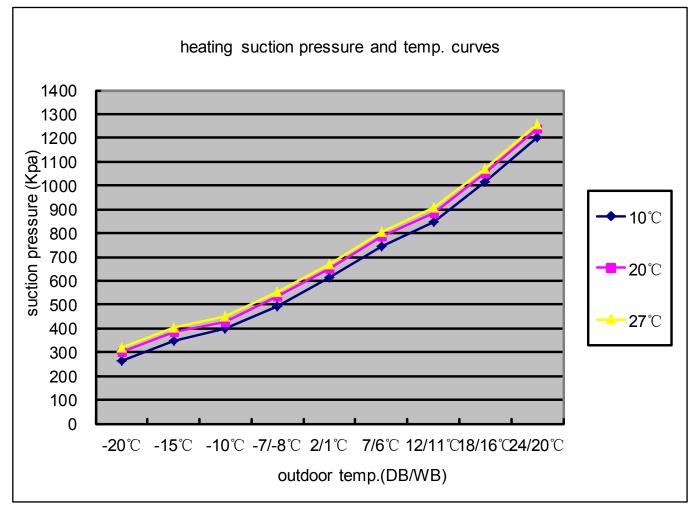

12.Sound level

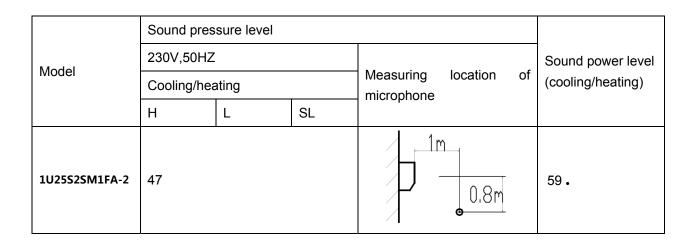

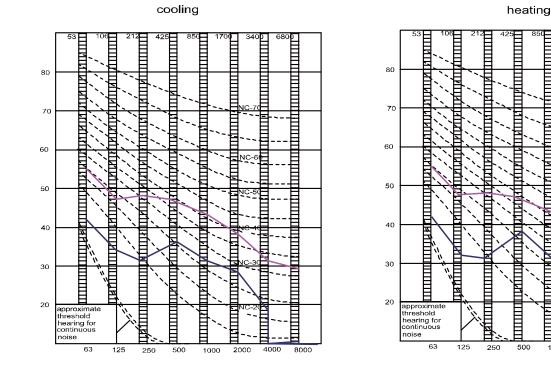



2000

4000


8000

1000

← INDOOR ← OUTDOOR

12. Circuit diagrams

12.1 Outdoor unit control board circuit diagrams

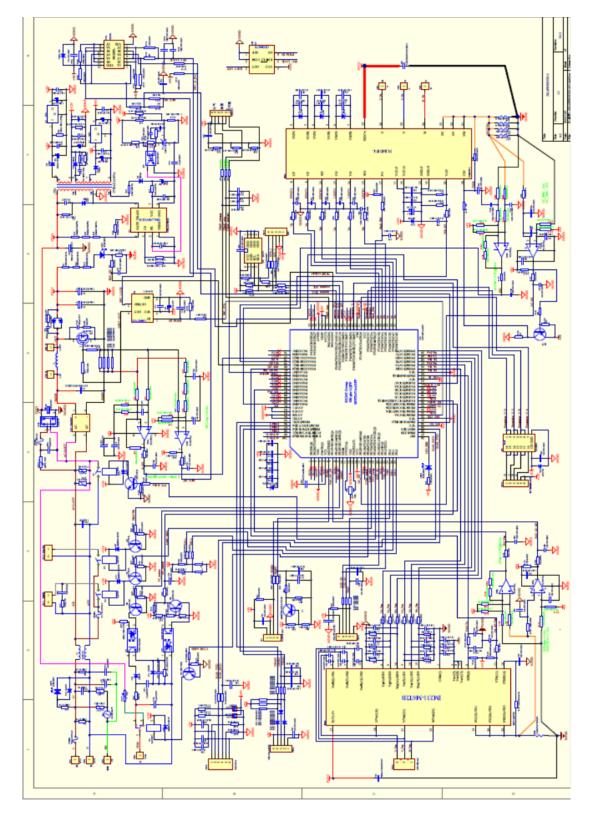

Generalny Dystrybutor Systemów Klimatyzacji i Pomp Ciepła w Polsce:

REFSYSTEM Sp. z o. o.

ul. Metalowców 5 86-300 Grudziądz +48 723 737 378 www.haier-ac.pl

Producent:

Qingdao Haier Air Conditioner Electric Co., Ltd.

Haier Industrial Park, Qianwangang Road, Eco-Tech Development Zone, Qingdao 266555, Shandong, R.P.C. +86 532 88936943 www.haier.com

Haier zastrzega sobie prawo do wprowadzania zmian bez wcześniejszego powiadomienia.